

MISSISSIPPI ASBESTOS DEMOLITION/RENOVATION NOTIFICATION FORM

Mail notification to: MDEQ Asbestos and Lead Branch, 515 E. Amite Street, Jackson, MS 39201

MDEQ Use Only: ☒ Email ☐ Mail ☐ Hand Delivery		Postmark (mail only)	Date Received 7/10/2025	AI Number
I. Type of Notification (O=Original R=Revised C=Canceled A= Annual): O				
II. TYPE OF OPERATION (D=Demo O= Ordered Demo R=Renovation E=Emer. Renovation): D				
III. FACILITY DESCRIPTION (Include building name, number and floor or room number): Proposed Dollar General Site				
Bldg. Name: Former Residence - Proposed Dollar General Site				
Address: 316 Hwy 11				
City: Poplarville		State: MS	Zip: 39470	
Site Location: Former Residence			Tel:	
Building Size: 2,350 SF		# of Floors: 1	Age in Years: 55	
Present Use: Vacant		Prior Use: Residence		
IV. FACILITY INFORMATION (Identify owner, asbestos removal contractor, and other operator)				
OWNER NAME: Dorsey Development, LLC				
Address: 3636 N. Causeway Blvd. , Suite 200				
City: Metairie		State: LA	Zip: 70002	
Contact: Greg Bivin			Tel: 504-593-0400	
ASBESTOS REMOVAL CONTRACTOR: Specialty Abatement Services, Inc.				
Address: PO Box 15925				
City: Hattiesburg		State: MS	Zip: 39404	
Contact: William Stamps			Tel: 601-264-5550	
Certification Number: ABC-00001660			Expiration Date: 2/7/2026	
OTHER OPERATOR: Owner				
Address:				
City:		State:	Zip:	
Contact:			Tel:	
V. WAS SITE INSPECTED TO DETERMINE PRESENCE OF ASBESTOS? (Yes/No): Yes				
WAS ASBESTOS PRESENT? (Yes/No): Yes			Inspection Date: 10/17/24	
Inspector: William Penick		Certification Number: ABI-00009048	Expiration Date: 7/19/25	
VI. SUSPECT MATERIALS SAMPLED AND PROCEDURES USED TO DETECT THE PRESENCE OF ASBESTOS MATERIAL: Floor Tile (2 types), Linoleum, Mastic (yellow) , Drywall w/ joint Cmpd, Textured Ceilings, Roofing materials. These materials were sampled using bulk sampling. These samples were analyzed by PLM at EMSL Analytical in Baton Rouge, LA.				
VII. QUANTITY OF RACM TO BE REMOVED:				
Pipes (LN FT):		Surface Area (SQ FT): 5,200 SF	Volume of Facility Components (CU FT):	
VIII. QUANTITY OF NONFRIABLE ASBESTOS NOT REMOVED:				
Category I:			Category II:	
IX. SCHEDULED DATES ASBESTOS REMOVAL (MM/DD/YY) Start: 7/23/2025			Complete: 8/1/2025	
X. SCHEDULED DATES DEMO/RENOVATION (MM/DD/YY) Start: 7/23/2025			Complete: 8/30/2025	

XI. DESCRIPTION OF PLANNED DEMOLITION OR RENOVATION WORK, AND METHOD(S) TO BE USED:

Floor Tile (9x9), Drywall Joint Cmpd & Texture will be removed using wet , manual methods. Prior to demoliton by others.

XII. DESCRIPTION OF WORK PRACTICES AND ENGINEERING CONTROLS TO BE USED TO PREVENT EMISSIONS OF ASBESTOS AT THE DEMOLITION OR RENOVATION SITE:

ACM will be removed using wet , manual methods.

Waste will be placed in a properly lined container for disposal.

XIII. WASTE TRANSPORTER #1

Name: Specialty Abatement Services, Inc.

Address: PO Box 15925

City: Hattiesburg

State: MS

Zip: 39404

Contact Person: William H. Stamps

Tel: 601-264-5550

WASTE TRANSPORTER #2

Name:

Address:

City:

State:

Zip:

Contact Person:

Tel:

XIV. WASTE DISPOSAL SITE

Name: Central Landfill

Address: 8800 Highway 11 North

City: McNeil

State: MS

Zip: 39457

Contact Person: Julie Dufrene

Tel: 601-813-0413

XV. IF DEMOLITION ORDERED BY A GOVERNMENT AGENCY, PLEASE IDENTIFY THE AGENCY BELOW:

Name:

Title:

Authority:

Date of Order (MM/DD/YY):

Date Ordered to Begin (MM/DD/YY):

XVI. FOR EMERGENCY RENOVATIONS:

Date and Hour of Emergency (MM/DD/YY):

Description of the sudden unexpected event:

Explanation of how the event caused unsafe conditions or would cause equipment damage or an unreasonable financial burden:

XVII. DESCRIPTION OF PROCEDURES TO BE FOLLOWED IN THE EVENT THAT UNEXPECTED ASBESTOS IS FOUND OR PREVIOUSLY NONFRIABLE ASBESTOS MATERIAL BECOMES CRUMBLED, PULVERIZED, OR REDUCED TO POWDER:

All work will stop. MDEQ will be notified.

XVIII. I CERTIFY THAT AN INDIVIDUAL TRAINED IN THE PROVISIONS OF THIS REGULATION (40 CFR PART 61, SUBPART M) WILL BE ONSITE DURING THE DEMOLITION OR RENOVATION, AND EVIDENCE THAT THE REQUIRED TRAINING HAS BEEN ACCOMPLISHED BY THIS PERSON WILL BE AVAILABLE FOR INSPECTION DURING NORMAL BUSINESS HOURS.

Anthony Bryant

Type or Print Name

(Signature of Owner/Operator)

7/10/2025

(Date)

XIX. I CERTIFY THAT THE ABOVE INFORMATION IS CORRECT:

Anthony Bryant

Type or Print Name

(Signature of Owner/Operator)

7/10/2025

(Date)

ASBESTOS SURVEY



PROPOSED DOLLAR GENERAL STORE

NORTHWEST CORNER OF HIGHWAY 11 AND W MICHIGAN STREET
POPLARVILLE, MISSISSIPPI 39470

ECS PROJECT NO. 49:24405

FOR: DORSEY DEVELOPMENT, LLC

OCTOBER 25, 2024





"One Firm. One Mission."

Geotechnical • Construction Materials • Environmental • Facilities

October 25, 2024

Mr. Greg Bivin
Dorsey Development, LLC
3636 N. Causeway, Suite 200
Metairie, Louisiana 70002
gregb@dorseydevelopment.com

ECS Project No. 49:24405

Reference: Asbestos Survey, Proposed Dollar General Store, Northwest Corner of Highway 11 and W Michigan Street, Poplarville, Mississippi

Dear Mr. Bivin:

ECS Southeast, LLC (ECS) is pleased to provide Dorsey Development, LLC with the results of the above referenced Asbestos Survey performed at the Proposed Dollar General Store located on the Northwest Corner of Highway 11 and W Michigan Street in Poplarville, Mississippi. This report summarizes our observations, analytical results, findings, and recommendations related to the work performed. The work described in this report was performed by ECS in general accordance with the Scope of Services described in ECS Proposal Number 49:47215P and the terms and conditions of the agreement authorizing those services.

ECS appreciates this opportunity to provide Dorsey Development, LLC with our services. If we can be of further assistance to you, please do not hesitate to contact us.

Sincerely,

ECS Southeast, LLC

Bill Penick
Environmental Senior Project Manager
bpenick@ecslimited.com
225-224-2583

Lindsey Thompson, REM
Environmental Principal
lthompson@ecslimited.com
864-987-1810

11211 Industriplex Boulevard, Baton Rouge, Louisiana 70809 • T:225-224-2583

ECS Florida, LLC • ECS Mid-Atlantic LLC • ECS Midwest, LLC • ECS Pacific, Inc. • ECS Southeast, LLC • ECS Southwest, LLP
ECS New York Engineering, PLLC - An Associate of ECS Group of Companies • ecslimited.com

"ONE FIRM. ONE MISSION."

EXECUTIVE SUMMARY

The subject property is improved with a single-family dwelling located on the Northwest Corner of Highway 11 and W Michigan Street, in Poplarville, Pearl River County, Mississippi. The structure consists of approximately 2,350 square feet and was reportedly originally constructed in 1970. At the time of our survey the building was unoccupied and is currently scheduled to be demolished.

The purpose of the survey was to determine whether asbestos-containing materials (ACMs) are present on the subject property. The survey was performed within interior and exterior areas of the subject building as well as the roof.

On October 17, 2024, Mr. Bill Penick, a (Mississippi Asbestos Inspector No. ABI-00009048), performed the asbestos assessment. Bulk samples were submitted to EMSL Analytical, Inc. (EMSL) in Baton Rouge, Louisiana for analysis via Polarized Light Microscopy (PLM) in accordance with the current EPA-600 methodology.

A total of 29 bulk samples from seven homogeneous areas were submitted to the laboratory, of which 67 layers were analyzed. Based on the laboratory analysis of the bulk samples collected during the survey, four of the materials were reported to contain asbestos.

The following materials were reported to be asbestos-containing:

- **Tan 9" x 9" floor tiles - 2% Chrysotile**
- **Tan texture - 3% Chrysotile;**
- **Tan joint-compound - 4% Chrysotile; and**
- **Tan joint-compound - 3% Chrysotile.**

The following materials were reported as non-asbestos containing:

- Yellow mastic;
- Brown linoleum;
- Brown floor tiles;
- Gray drywall;
- Black and brown shingles;
- Black tar; and
- Black felt paper.

Due to inaccessibility or the destructive means that asbestos sampling requires, unseen ACMs may remain within the building hidden behind inaccessible areas, which include, but are not limited to, sub-grade walls, structural members, topping slabs, sub-grade sealants, flooring located below underlayments, areas behind exterior walls, pipe trenches, and subsurface utilities.

If suspect materials are discovered during construction activities, they should be presumed to contain asbestos and be treated as ACMs or be sampled immediately upon discovery and prior to disturbance for asbestos content by an accredited or certified asbestos inspector in accordance with 29 Code of Federal Regulations (CFR) 1926.1101.

Recommendations regarding the removal and disposal of the ACM identified by ECS can be found in Section 5.0 of this report.

The executive summary is an integral portion of this report, however, ECS recommends the report be read in its entirety.

TABLE OF CONTENTS

PAGE

1.0	SITE DESCRIPTION	1
2.0	PURPOSE	1
3.0	METHODOLOGY	1
3.1	Asbestos-Containing Materials	1
4.0	RESULTS	2
4.1	Asbestos Sampling	2
4.2	Suspect or Assumed Asbestos-Containing Materials	4
5.0	RECOMMENDATIONS AND REGULATORY REQUIREMENTS	4
5.1	Asbestos-Containing Materials	4
6.0	LIMITATIONS	5

TABLE OF APPENDICES

Appendix I: Figures

Appendix II: Site Photographs

Appendix III: Asbestos Bulk Sample Results

Appendix IV: Asbestos Demolition Permit Form

Appendix V: Certifications/Licenses

1.0 SITE DESCRIPTION

The approximately 1.5-acre subject property is currently partially wooded land with a residential structure on the northern section of the subject property. The residential structure consists of approximately 2,350 square feet and was constructed in the early 1970s. The structure is constructed of brick and wood siding and contains a living room, bedrooms, kitchen, bathroom, and utility room.

2.0 PURPOSE

The purpose of the Asbestos Survey was to identify asbestos-containing materials (ACMs) which require special handling and/or disposal if disturbed during construction activities. The identification of ACMs require trained labor, regulated work practices, and special disposal.

3.0 METHODOLOGY

ECS performed the authorized Scope of Services in general accordance with our proposal, standard industry practice(s) and methods specified by regulation(s) for the identification of ACMs.

3.1 Asbestos-Containing Materials

The asbestos survey was performed by Mr. Bill Penick, a (Mississippi Asbestos Inspector No. ABI-00009048), on October 17, 2024. The survey consisted of observing the accessible areas of the building for the presence of suspect materials which may contain asbestos. The survey involved detecting both friable materials (materials which can be pulverized or reduced to a powder by hand pressure when dry) and non-friable materials (materials which pose a hazard when sawn, sanded, drilled or pulverized). Homogeneous materials (based on material type, color, texture, etc.) were identified during the survey.

The EPA National Emissions Standard for Hazardous Air Pollutants (NESHAP) requires a survey for asbestos prior to renovation or demolition. Demolition is defined under NESHAP as the removal of a load-bearing structural member and renovation is an action which disturbs building materials. On the basis of requirements under NESHAP and the Mississippi Department of Environmental Quality (MDEQ) for renovation or demolition activities, ECS conducted a limited survey for potential ACM. The ACM survey was limited in that we did not conduct demolition such as jack/sledgehammering to expose potentially concealed materials. Samples were collected in general accordance with Environmental Protection Agency (EPA) Standard 40 CFR 763 Subpart E, Asbestos Hazard Emergency Response Act (AHERA) and Occupational Safety and Health Administration (OSHA) Standard 29 CFR 1926.1101 Inspection Protocol.

Representative bulk samples were collected, placed in sealed packages, and submitted to EMSL Analytical, Inc. (EMSL) for analysis using the EPA recommended method of Polarized Light Microscopy (PLM) coupled with dispersion staining (Method No. EPA 600/R-93/116). EMSL participates in the National Voluntary Laboratory Accreditation Program (NVLAP). Their NVLAP accreditation number is 200375-0. Several of the samples were layered and analyzed as multiple samples. EPA regulations require that multiple samples of each homogeneous area be collected for laboratory analysis. The material type, sample location, and analytical results of each bulk sample are also summarized in the attached Asbestos Bulk Analysis report in **Appendices**.



During the survey, ECS attempted to identify suspect ACMs in readily accessible areas. However, due to the destructive means required to identify some materials, certain areas were deemed inaccessible (i.e. behind walls or sub grade materials) and were not surveyed for suspect ACMs. Unidentified suspect ACMs may be located in these and/or other inaccessible areas.

Samples were collected in general accordance with EPA Standard 40 CFR 763 Subpart E, Asbestos Hazard Emergency Response Act (AHERA) and OSHA Standard 29 CFR 1926.1101 Inspection Protocol. Multiple samples of each unique material were submitted.

4.0 RESULTS

The following is a summary of laboratory results, findings and observations.

4.1 Asbestos Sampling

In total, 29 bulk samples from seven homogeneous areas were submitted to the laboratory, of which 67 layers were analyzed.

An ACM is defined as any material containing more than one percent (>1%) asbestos as determined using the method specified in Appendix E, Subpart E, 40 CFR Part 763, Section 1, PLM. Materials are categorized by the U.S. EPA in the following categories:

- Friable ACMs are defined as any ACM that, when dry, can be crumbled, pulverized, or reduced to powder by hand pressure. Non-friable ACMs are defined as any ACM that, when dry, cannot be crumbled, pulverized, or reduced to powder by hand pressure.
- Category I non-friable ACMs include packings, gaskets, resilient floor coverings, and asphalt roofing products containing more than one percent (>1%) asbestos.
- Category II non-friable ACM are listed as any material, excluding Category I non-friable ACM, containing more than one percent (>1%) asbestos.

Regulated Asbestos Containing Materials (RACM) are friable ACM or non-friable ACM that will be or has been subjected to sanding, grinding, cutting, or abrading or has crumbled, been pulverized, or reduced to powder in the course of renovation and/or demolition operations.

EMSL submitted a signed final laboratory report to ECS on October 22, 2024. Four materials submitted for analysis were reported to contain asbestos in detectable concentrations. A complete list of the sampled materials submitted for analysis and material locations are included below. Photographs of representative building materials are located in Appendix II of this report.

Asbestos Bulk Sample Locations and Analysis Results

Sample ID	Material Location	Material Description	Analytical Results	Category	Estimated Quantity
A - 1, 2, 3	Kitchen	Brown and white floor tiles and yellow mastic	FT Non-detect-(ND) Mastic-ND	Not Applicable (NA)	Approximately 300 square feet (SF)
A - 4, 5, 6, 7, 8	Living room, kitchen, and bedrooms	Tan 9" x 9" floor tiles and yellow mastic	FT - 2% Chrysotile Mastic - ND	Category 1	Approximately 1,500 SF
A - 9, 10, 11	Utility room	Brown linoleum and yellow mastic	Linoleum - ND mastic - ND	NA	Approximately 150 SF
A - 12, 13, 14, 15, 16	Throughout	Gray drywall ceiling, tan texture, and tan joint-compound	Drywall - ND Texture - 3% Chrysotile JC - 4% Chrysotile	Category II	Approximately 2,300 SF
A - 17, 18, 19	Living room	Gray drywall and tan joint-compound	Drywall - ND JC - 3% Chrysotile	Category II	Approximately 400 SF
A - 20, 21, 22, 23, 24	Bedrooms, hall, and kitchen	Gray drywall and tan joint-compound	Drywall - ND JC - 3% Chrysotile	Category II	Approximately 1,000 SF
R - 1, 2, 3, 4, 5	Roof	Brown and black shingles, black tar, and black felt paper	Shingles -ND Tar - ND Felt - ND	NA	Approximately 2,350 SF

The above provided approximate quantities of the identified ACMs are for informational purposes only and should not be used for bidding purposes. ECS does not warranty or guarantee the estimated quantities provided. The contractors bidding on asbestos abatement

work should visit the site prior to bidding to field verify the estimated quantities of ACMs and become familiar with the site conditions and address any technical or engineering considerations with respect to asbestos removal in their bids or estimates. Any similar materials located on the property should also be assumed to contain asbestos unless tested and the laboratory analysis indicates that asbestos is not present.

4.2 Suspect or Assumed Asbestos-Containing Materials

Due to the inaccessibility or the destructive means that asbestos sampling requires, additional suspect ACMs may remain within the building hidden behind inaccessible areas that include, but are not limited to, sub-grade walls, structural members, topping slabs, sub-grade sealants, flooring located below underlayments, areas behind exterior walls, pipe trenches, and subsurface utilities, etc. These areas were deemed inaccessible and were not assessed.

- Roof penetration mastic
- Sub-slab vapor barriers

If these materials are discovered during construction activities, they should be presumed to contain asbestos and be treated as ACMs or be sampled immediately upon discovery and prior to disturbance for asbestos content by a certified asbestos inspector in accordance with 29 CFR 1926.1101.

5.0 RECOMMENDATIONS AND REGULATORY REQUIREMENTS

Based on our understanding of the purpose of the Asbestos Survey, the results of laboratory analysis, and our findings and observations, ECS presents the following recommendations.

5.1 Asbestos-Containing Materials

ECS recommends where a material type has been identified as asbestos-containing that, other materials with similar color, texture, age, and size throughout the building's interior and exterior be assumed to contain asbestos. Please refer to Section 4.1 for a complete list of building materials reported positive for asbestos and Section 4.2 for materials assumed to contain asbestos. Identified ACMs must be removed, encapsulated, or enclosed before disturbance of the materials.

Before abatement and demolition begins, a Mississippi Asbestos Demolition/Renovation Notification Form must be completed and sent to the Mississippi Department of Environmental Quality (MDEQ) at least 10 working days before removal begins. The Mississippi Asbestos Form is attached in Appendix IV.

If ACMs are to be removed, an accredited asbestos abatement contractor should perform the removal. It is recommended that an industrial hygienist monitor the project. This involves collecting air samples from within and outside abatement work areas to monitor the asbestos abatement contractor's work practices throughout the project. The industrial hygienist should evaluate if the asbestos abatement work is in accordance with project specifications, U.S. EPA regulation 40 CFR Part 61-NESHAP Subpart M: National Emission Standard for Asbestos, and OSHA regulation 29 CFR 1926.1101 – Asbestos in Construction. The industrial hygienist should assess each work area to monitor the removal of ACMs. Only after the industrial hygienist has determined the identified ACMs have been removed should final clearance air samples be collected (if necessary).



Suspect ACMs not observed due to inaccessibility or not sampled due to the destructive means that sampling would require may also be encountered during construction activities. At the time of the survey, only limited destructive means were used to locate or sample suspect ACMs; therefore, additional suspect ACMs may remain within inaccessible areas that include, but are not limited to sub-grade walls, structural members, topping slabs, exterior areas, sub-grade sealants, flooring located below underlayments, vapor barriers, pipe trenches, and other subsurface utilities. If additional suspect ACMs are uncovered which were not accessible during this survey, it is recommended that these materials either be assumed to contain asbestos or be sampled before disturbance upon discovery for asbestos content by an asbestos inspector in accordance with 29 CFR 1926.1101.

6.0 LIMITATIONS

The conclusions and recommendations presented within this report are based upon a reasonable level of assessment within normal bounds and standards of professional practice for a site in this particular geographic setting. ECS is not responsible or liable for the discovery and elimination of hazards that may potentially cause damage, accidents, or injuries.

The observations, conclusions, and recommendations pertaining to environmental conditions at the subject site are necessarily limited to conditions observed, and/or materials reviewed at the time this study was undertaken. No warranty, expressed or implied, is made with regard to the conclusions and recommendations presented within this report. This report is provided for the exclusive use of the client. This report is not intended to be used or relied upon in connection with other projects or by other unidentified third parties without the written consent of ECS and the client.

During this study, samples were submitted for analysis at an accredited laboratory via polarized light microscopy. As with any similar survey of this nature, actual conditions exist only at the precise locations from which samples were collected. Certain inferences are based on the results of this sampling and related testing to form a professional opinion of conditions in areas beyond those from which the samples were collected. No warranty, expressed or implied, is made.

Our recommendations are in part based on federal, state, and local regulations and guidelines. ECS does not assume the responsibility of the person(s) in charge of the site, or otherwise undertake responsibility for reporting to any local, state, or federal public agencies, any conditions at the site that may present a potential danger to public health, safety, or the environment. Under this scope of services, ECS assumes no responsibility regarding any response actions initiated as a result of these findings. General compliance with regulations and response actions are the sole responsibility of the Client and should be conducted in accordance with local, state, and/or federal requirements.

Appendix I: Figures



Figure 1

Site Location Map
Proposed Dollar General Store
Highway 11 and W Michigan Street
Poplarville, Mississippi
ECS Project No. 49-24405

Source: Google Earth





Figure 2

Sample Locations
 Proposed Dollar General Store
 Highway 11 and W Michigan Street
 Poplarville, Mississippi
 ECS Project No. 49-24405

LEGEND

- A-X** Sample Location
- ▲ ACM Detected
- ⊗ Asbestos Sample Negative

NOTES:

- Not to scale
- Samples color coded

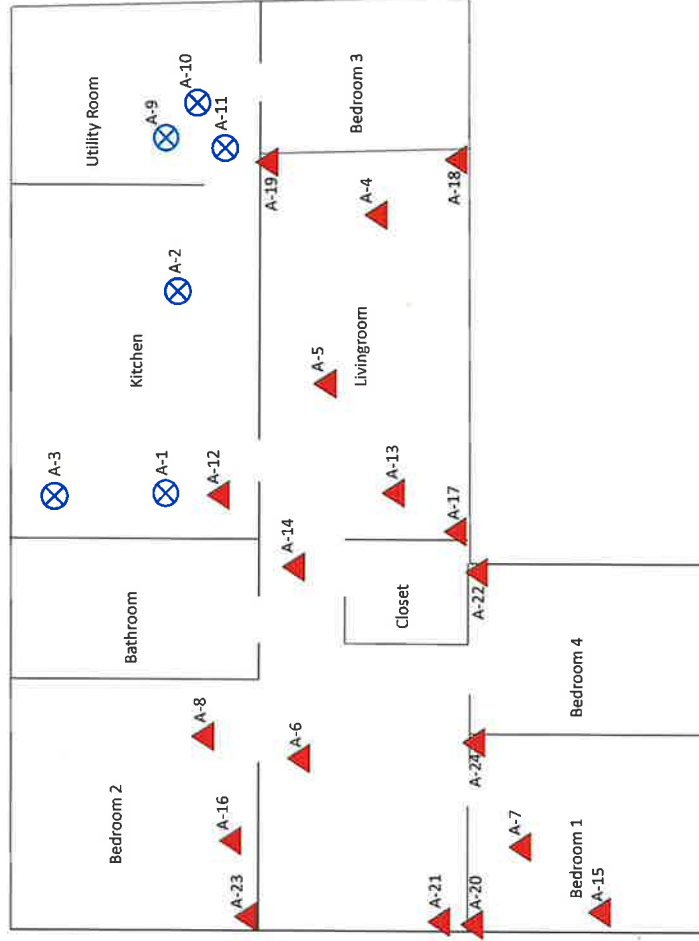




Figure 3

Roof Sample Locations
Proposed Dollar General Store
Highway 11 and W Michigan Street
Poplarville, Mississippi
ECS Project No. 49-24405

LEGEND

R-X

Sample Location




Asbestos Sample Negative

NOTES:

Not to scale

Samples color coded

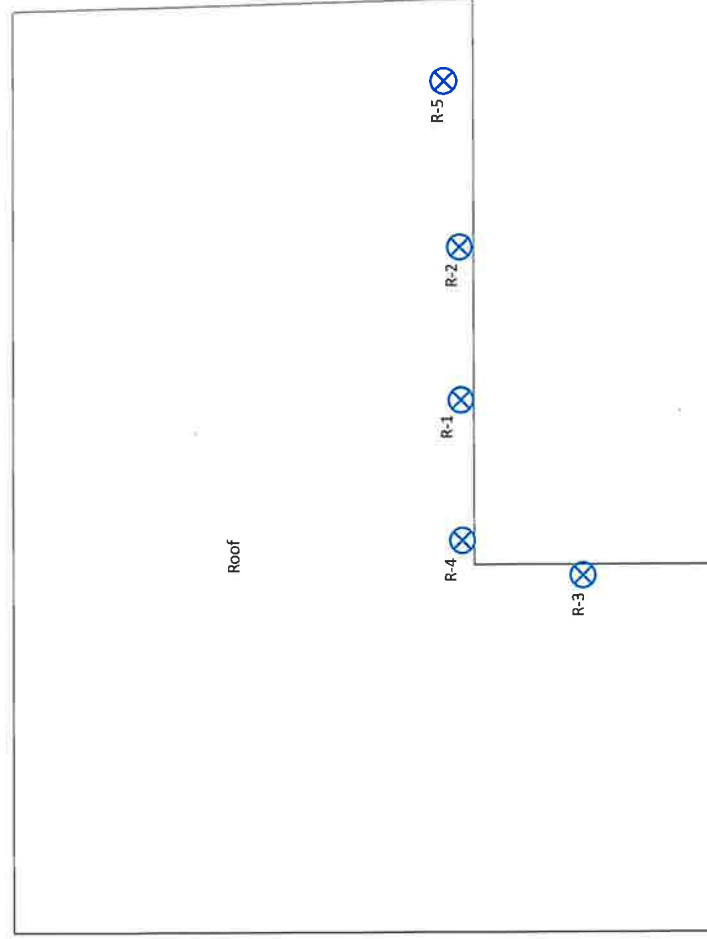

Appendix II: Site Photographs

October 25, 2024



1 - Appearance of the residential structure on the subject property.



2 - View of the kitchen

October 25, 2024



3 - View of the living room (ACM drywall)



4 - View of a typical bedroom

October 25, 2024



5 - View of the tan 9" x 9" floor tiles (ACM)



6 - View of the brown linoleum

October 25, 2024



7 - View of the of brown linoleum



8 - View of the roof

Appendix III: Asbestos Bulk Sample Results



EMSL Analytical, Inc.

18369 Petroleum Drive Baton Rouge, LA 70809
Tel/Fax: (225) 755-1920 / (225) 755-1989
<http://www.EMSL.com> / batonrougelab@emsl.com

EMSL Order: 252404617

Customer ID: ENCS55

Customer PO:

Project ID:

Attention: Bill Penick

ECS Southeast, LLC

1200 Woodruff Rd.

Greenville, SC 29607

Phone: (225) 771-9629

Fax: (864) 987-1615

Received Date: 10/17/2024 3:20 PM

Analysis Date: 10/21/2024

Collected Date: 10/17/2024

Project: 49-24405 Asbestos Survey

Test Report: Asbestos Analysis of Bulk Materials via AHERA Method 40CFR 763 Subpart E Appendix E supplemented with EPA 600/R-93/116 using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos % Type
			% Fibrous	% Non-Fibrous	
A-1-Floor Tile 252404617-0001	Kitchen - Brown Floor Tiles & Mastic	Brown/White Non-Fibrous Homogeneous	HA: 1	100% Non-fibrous (Other)	None Detected
A-1-Mastic 252404617-0001A	Kitchen - Brown Floor Tiles & Mastic	Yellow Non-Fibrous Homogeneous	HA: 1	100% Non-fibrous (Other)	None Detected
A-2-Floor Tile 252404617-0002	Kitchen - Brown Floor Tiles & Mastic	Brown/White Non-Fibrous Homogeneous	HA: 1	100% Non-fibrous (Other)	None Detected
A-2-Mastic 252404617-0002A	Kitchen - Brown Floor Tiles & Mastic	Yellow Non-Fibrous Homogeneous	HA: 1	100% Non-fibrous (Other)	None Detected
A-3-Floor Tile 252404617-0003	Kitchen - Brown Floor Tiles & Mastic	Brown/White Non-Fibrous Homogeneous	HA: 1	100% Non-fibrous (Other)	None Detected
A-3-Mastic 252404617-0003A	Kitchen - Brown Floor Tiles & Mastic	Yellow Non-Fibrous Homogeneous	HA: 1	100% Non-fibrous (Other)	None Detected
A-4-Floor Tile 252404617-0004	Living Room, Kitchen, Bedrooms - Tan 9"x 9" Floor Tiles & Mastic	Tan Non-Fibrous Homogeneous	HA: 2	98% Non-fibrous (Other)	2% Chrysotile
A-4-Mastic 252404617-0004A	Living Room, Kitchen, Bedrooms - Tan 9"x 9" Floor Tiles & Mastic	Yellow Non-Fibrous Homogeneous	HA: 2	100% Non-fibrous (Other)	None Detected
A-5-Floor Tile 252404617-0005	Living Room, Kitchen, Bedrooms - Tan 9"x 9" Floor Tiles & Mastic	Tan Non-Fibrous Homogeneous	HA: 2	98% Non-fibrous (Other)	2% Chrysotile
A-5-Mastic 252404617-0005A	Living Room, Kitchen, Bedrooms - Tan 9"x 9" Floor Tiles & Mastic	Yellow Non-Fibrous Homogeneous	HA: 2	100% Non-fibrous (Other)	None Detected
A-6-Floor Tile 252404617-0006	Living Room, Kitchen, Bedrooms - Tan 9"x 9" Floor Tiles & Mastic	Tan Non-Fibrous Homogeneous	HA: 2	98% Non-fibrous (Other)	2% Chrysotile

Initial report from: 10/22/2024 10:55:04

**EMSL Analytical, Inc.**

18369 Petroleum Drive Baton Rouge, LA 70809

Tel/Fax: (225) 755-1920 / (225) 755-1989

<http://www.EMSL.com> / batonrougelab@emsl.com**EMSL Order:** 252404617**Customer ID:** ENCS55**Customer PO:****Project ID:****Test Report: Asbestos Analysis of Bulk Materials via AHERA Method 40CFR 763 Subpart E
Appendix E supplemented with EPA 600/R-93/116 using Polarized Light Microscopy**

Sample	Description	Appearance	% Fibrous	Non-Asbestos	Asbestos
				% Non-Fibrous	% Type
A-6-Mastic 252404617-0006A	Living Room, Kitchen, Bedrooms - Tan 9"x 9" Floor Tiles & Mastic	Yellow Non-Fibrous Homogeneous	HA: 2	100% Non-fibrous (Other)	None Detected
A-7-Floor Tile 252404617-0007	Living Room, Kitchen, Bedrooms - Tan 9"x 9" Floor Tiles & Mastic	Tan Non-Fibrous Homogeneous	HA: 2	98% Non-fibrous (Other)	2% Chrysotile
A-7-Mastic 252404617-0007A	Living Room, Kitchen, Bedrooms - Tan 9"x 9" Floor Tiles & Mastic	Yellow Non-Fibrous Homogeneous	HA: 2	100% Non-fibrous (Other)	None Detected
A-8-Floor Tile 252404617-0008	Living Room, Kitchen, Bedrooms - Tan 9"x 9" Floor Tiles & Mastic	Tan Non-Fibrous Homogeneous	HA: 2	98% Non-fibrous (Other)	2% Chrysotile
A-8-Mastic 252404617-0008A	Living Room, Kitchen, Bedrooms - Tan 9"x 9" Floor Tiles & Mastic	Yellow Non-Fibrous Homogeneous	HA: 2	100% Non-fibrous (Other)	None Detected
A-9-Linoleum 252404617-0009	Store Room - Brown Linoleum & Mastic	Brown Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected
A-9-Mastic 252404617-0009A	Store Room - Brown Linoleum & Mastic	Yellow Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected
A-10-Linoleum 252404617-0010	Store Room - Brown Linoleum & Mastic	Brown Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected
A-10-Mastic 252404617-0010A	Store Room - Brown Linoleum & Mastic	Yellow Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected
A-11-Linoleum 252404617-0011	Store Room - Brown Linoleum & Mastic	Brown Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected
A-11-Mastic 252404617-0011A	Store Room - Brown Linoleum & Mastic	Yellow Non-Fibrous Homogeneous	HA: 3	100% Non-fibrous (Other)	None Detected
A-12-Texture 252404617-0012	Throughout - White & Tan drywall ceiling	Tan Non-Fibrous Homogeneous	HA: 4	97% Non-fibrous (Other)	3% Chrysotile
A-12-Joint Compound 252404617-0012A	Throughout - White & Tan drywall ceiling	Tan Non-Fibrous Homogeneous	HA: 4	96% Non-fibrous (Other)	4% Chrysotile

Initial report from: 10/22/2024 10:55:04



EMSL Analytical, Inc.

18369 Petroleum Drive Baton Rouge, LA 70809

Tel/Fax: (225) 755-1920 / (225) 755-1989

<http://www.EMSL.com/batonrougelab@emsl.com>

EMSL Order: 252404617

Customer ID: ENCS55

Customer PO:

Project ID:

Test Report: Asbestos Analysis of Bulk Materials via AHERA Method 40CFR 763 Subpart E Appendix E supplemented with EPA 600/R-93/116 using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos % Type
			% Fibrous	% Non-Fibrous	
A-12-Drywall 252404617-0012B	Throughout - White & Tan drywall ceiling	Gray Non-Fibrous Homogeneous HA: 4		100% Non-fibrous (Other)	None Detected
A-13-Texture 252404617-0013	Throughout - White & Tan drywall ceiling	Tan Non-Fibrous Homogeneous HA: 4		97% Non-fibrous (Other)	3% Chrysotile
A-13-Joint Compound 252404617-0013A	Throughout - White & Tan drywall ceiling	Tan Non-Fibrous Homogeneous HA: 4		96% Non-fibrous (Other)	4% Chrysotile
A-13-Drywall 252404617-0013B	Throughout - White & Tan drywall ceiling	Gray Non-Fibrous Homogeneous HA: 4		100% Non-fibrous (Other)	None Detected
A-14-Texture 252404617-0014	Throughout - White & Tan drywall ceiling	Tan Non-Fibrous Homogeneous HA: 4		97% Non-fibrous (Other)	3% Chrysotile
A-14-Joint Compound 252404617-0014A	Throughout - White & Tan drywall ceiling	Tan Non-Fibrous Homogeneous HA: 4		96% Non-fibrous (Other)	4% Chrysotile
A-14-Drywall 252404617-0014B	Throughout - White & Tan drywall ceiling	Gray Non-Fibrous Homogeneous HA: 4		100% Non-fibrous (Other)	None Detected
A-15-Texture 252404617-0015	Throughout - White & Tan drywall ceiling	Tan Non-Fibrous Homogeneous HA: 4		97% Non-fibrous (Other)	3% Chrysotile
A-15-Joint Compound 252404617-0015A	Throughout - White & Tan drywall ceiling	Tan Non-Fibrous Homogeneous HA: 4		96% Non-fibrous (Other)	4% Chrysotile
A-15-Drywall 252404617-0015B	Throughout - White & Tan drywall ceiling	Gray Non-Fibrous Homogeneous HA: 4		100% Non-fibrous (Other)	None Detected
A-16-Texture 252404617-0016	Throughout - White & Tan drywall ceiling				Layer Not Present
A-16-Joint Compound 252404617-0016A	Throughout - White & Tan drywall ceiling	Tan Non-Fibrous Homogeneous HA: 4		96% Non-fibrous (Other)	4% Chrysotile
A-16-Drywall 252404617-0016B	Throughout - White & Tan drywall ceiling	Gray Non-Fibrous Homogeneous HA: 4		100% Non-fibrous (Other)	None Detected
A-17-Joint Compound 252404617-0017	Living Room - Tan & White drywall and JC	Tan Non-Fibrous Homogeneous HA: 5		97% Non-fibrous (Other)	3% Chrysotile
A-17-Drywall 252404617-0017A	Living Room - Tan & White drywall and JC	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected

Initial report from: 10/22/2024 10:55:04



EMSL Analytical, Inc.

18369 Petroleum Drive Baton Rouge, LA 70809

Tel/Fax: (225) 755-1920 / (225) 755-1989

<http://www.EMSL.com> / batonrougelab@emsl.com

EMSL Order: 252404617

Customer ID: ENCS55

Customer PO:

Project ID:

Test Report: Asbestos Analysis of Bulk Materials via AHERA Method 40CFR 763 Subpart E Appendix E supplemented with EPA 600/R-93/116 using Polarized Light Microscopy

		Non-Asbestos		Asbestos	
Sample	Description	Appearance	% Fibrous	% Non-Fibrous	% Type
			HA: 5		
A-18-Joint Compound 252404617-0018	Living Room - Tan & White drywall and JC	Tan Non-Fibrous Homogeneous		97% Non-fibrous (Other)	3% Chrysotile
			HA: 5		
A-18-Drywall 252404617-0018A	Living Room - Tan & White drywall and JC	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 5		
A-19-Joint Compound 252404617-0019	Living Room - Tan & White drywall and JC	Tan Non-Fibrous Homogeneous		97% Non-fibrous (Other)	3% Chrysotile
			HA: 5		
A-19-Drywall 252404617-0019A	Living Room - Tan & White drywall and JC	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 5		
A-20-Joint Compound 252404617-0020	Bedrooms, Hall, Kitchen - White drywall & JC	Tan Non-Fibrous Homogeneous		97% Non-fibrous (Other)	3% Chrysotile
			HA: 6		
A-20-Drywall 252404617-0020A	Bedrooms, Hall, Kitchen - White drywall & JC	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 6		
A-21-Joint Compound 252404617-0021	Bedrooms, Hall, Kitchen - White drywall & JC	Tan Non-Fibrous Homogeneous		97% Non-fibrous (Other)	3% Chrysotile
			HA: 6		
A-21-Drywall 252404617-0021A	Bedrooms, Hall, Kitchen - White drywall & JC	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 6		
A-22-Joint Compound 252404617-0022	Bedrooms, Hall, Kitchen - White drywall & JC	Tan Non-Fibrous Homogeneous		97% Non-fibrous (Other)	3% Chrysotile
			HA: 6		
A-22-Drywall 252404617-0022A	Bedrooms, Hall, Kitchen - White drywall & JC	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 6		
A-23-Joint Compound 252404617-0023	Bedrooms, Hall, Kitchen - White drywall & JC	Tan Non-Fibrous Homogeneous		97% Non-fibrous (Other)	3% Chrysotile
			HA: 6		
A-23-Drywall 252404617-0023A	Bedrooms, Hall, Kitchen - White drywall & JC	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 6		
A-24-Joint Compound 252404617-0024	Bedrooms, Hall, Kitchen - White drywall & JC	Tan Non-Fibrous Homogeneous		97% Non-fibrous (Other)	3% Chrysotile
			HA: 6		
A-24-Drywall 252404617-0024A	Bedrooms, Hall, Kitchen - White drywall & JC	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
			HA: 6		

Initial report from: 10/22/2024 10:55:04



EMSL Analytical, Inc.

18369 Petroleum Drive Baton Rouge, LA 70809

Tel/Fax: (225) 755-1920 / (225) 755-1989

<http://www.EMSL.com> / batonrougelab@emsl.com

EMSL Order: 252404617

Customer ID: ENCS55

Customer PO:

Project ID:

Test Report: Asbestos Analysis of Bulk Materials via AHERA Method 40CFR 763 Subpart E Appendix E supplemented with EPA 600/R-93/116 using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
R-1-Shingle 252404617-0025	Roof - Brown Shingles, Tar, Felt paper	Black Fibrous Homogeneous	15% Glass HA: 7	85% Non-fibrous (Other)	None Detected
R-1-Tar 252404617-0025A	Roof - Brown Shingles, Tar, Felt paper	Black Non-Fibrous Homogeneous	HA: 7	100% Non-fibrous (Other)	None Detected
R-1-Tar Paper 252404617-0025B	Roof - Brown Shingles, Tar, Felt paper	Black Fibrous Homogeneous	60% Cellulose HA: 7	40% Non-fibrous (Other)	None Detected
R-2-Shingle 252404617-0026	Roof - Brown Shingles, Tar, Felt paper	Black Fibrous Homogeneous	15% Glass HA: 7	85% Non-fibrous (Other)	None Detected
R-2-Tar 252404617-0026A	Roof - Brown Shingles, Tar, Felt paper	Black Non-Fibrous Homogeneous	HA: 7	100% Non-fibrous (Other)	None Detected
R-2- Tar Paper 252404617-0026B	Roof - Brown Shingles, Tar, Felt paper	Black Fibrous Homogeneous	60% Cellulose HA: 7	40% Non-fibrous (Other)	None Detected
R-3-Shingle 252404617-0027	Roof - Brown Shingles, Tar, Felt paper	Black Fibrous Homogeneous	15% Glass HA: 7	85% Non-fibrous (Other)	None Detected
R-3-Tar 252404617-0027A	Roof - Brown Shingles, Tar, Felt paper	Black Non-Fibrous Homogeneous	HA: 7	100% Non-fibrous (Other)	None Detected
R-3-Tar Paper 252404617-0027B	Roof - Brown Shingles, Tar, Felt paper	Black Fibrous Homogeneous	60% Cellulose HA: 7	40% Non-fibrous (Other)	None Detected
R-4-Shingle 252404617-0028	Roof - Brown Shingles, Tar, Felt paper	Black Fibrous Homogeneous	15% Glass HA: 7	85% Non-fibrous (Other)	None Detected
R-4-Tar 252404617-0028A	Roof - Brown Shingles, Tar, Felt paper	Black Non-Fibrous Homogeneous	HA: 7	100% Non-fibrous (Other)	None Detected
R-4-Tar Paper 252404617-0028B	Roof - Brown Shingles, Tar, Felt paper	Black Fibrous Homogeneous	60% Cellulose HA: 7	40% Non-fibrous (Other)	None Detected
R-5-Shingle 252404617-0029	Roof - Brown Shingles, Tar, Felt paper	Black Fibrous Homogeneous	15% Glass HA: 7	85% Non-fibrous (Other)	None Detected
R-5-Tar 252404617-0029A	Roof - Brown Shingles, Tar, Felt paper	Black Non-Fibrous Homogeneous	HA: 7	100% Non-fibrous (Other)	None Detected
R-5-Tar Paper 252404617-0029B	Roof - Brown Shingles, Tar, Felt paper	Black Fibrous Homogeneous	60% Cellulose	40% Non-fibrous (Other)	None Detected

Initial report from: 10/22/2024 10:55:04



EMSL Analytical, Inc.

18369 Petroleum Drive Baton Rouge, LA 70809

Tel/Fax: (225) 755-1920 / (225) 755-1989

<http://www.EMSL.com> / batonrougelab@emsl.com

EMSL Order: 252404617

Customer ID: ENCS55

Customer PO:

Project ID:

Test Report: Asbestos Analysis of Bulk Materials via AHERA Method 40CFR 763 Subpart E Appendix E supplemented with EPA 600/R-93/116 using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
HA: 7					

Analyst(s)

Bailey Gunter (67)

Martiana Beach

Martiana Beach, Laboratory Manager
or Other Approved Signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. The above analyses were performed in general compliance with Appendix E to Subpart E of 40 CFR (previously EPA 600/M4-82-020 "Interim Method") but augmented with procedures outlined in the 1993 ("final") version of the method. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-friable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Estimation of uncertainty is available on request.

Samples analyzed by EMSL Analytical, Inc. Baton Rouge, LA NVLAP Lab Code 200375-0, LELAP 01950, TX 300238

Initial report from: 10/22/2024 10:55:04

EMSL ANALYTICAL, INC.
LABORATORY PRODUCTS TRAINING

Asbestos Bulk Building Material Chain of Custody

EMSL Order Number (Lab Use Only):

4617

EMSL ANALYTICAL, INC.
200 ROUTE 130 NORTH
CINNAMINSON, NJ 08077
PHONE: (800) 220-3675
FAX: (856) 786-5974

Company: <u>ECS Southeast, LLC</u>		EMSL-Bill to: ☐ Same ☐ Different If Bill to is Different note instructions in Comments**	
Street: <u>1200 Woodcroft Road</u>		Third Party Billing requires written authorization from third party	
City: <u>Greenville</u>	State/Province: <u>SC</u>	Zip/Postal Code: <u>29607</u>	Country: <u>US</u>
Report To (Name): <u>Bill Perick</u>		Telephone #: <u>225-224-2583</u>	
Email Address: <u>bperick@ecslimited.com</u>		Fax #:	Purchase Order:
Project Name/Number: <u>A-24405 Asbestos Survey</u>		Please Provide Results: ☐ Fax ☒ Email	
U.S. State Samples Taken: <u>MS</u>		CT Samples: ☐ Commercial/Taxable ☐ Residential/Tax Exempt	
Turnaround Time (TAT) Options* - Please Check			
☐ 3 Hour ☐ 6 Hour ☐ 24 Hour ☐ 48 Hour ☒ 72 Hour ☐ 96 Hour ☐ 1 Week ☐ 2 Week			
*For TEM Air 3 hr through 6 hr, please call ahead to schedule. There is a premium charge for 3 Hour TEM AHERA or EPA Level II TAT. You will be asked to sign an authorization form for this service. Analysis completed in accordance with EMSL's Terms and Conditions located in the Analytical Price Guide.			
PLM - Bulk (reporting limit)		TEM - Bulk	
☒ PLM EPA 600/R-93/116 (<1%) ☐ PLM EPA NOB (<1%) Point Count ☐ 400 (<0.25%) ☐ 1000 (<0.1%) Point Count w/Gravimetric ☐ 400 (<0.25%) ☐ 1000 (<0.1%) ☐ NIOSH 9002 (<1%) ☐ NY ELAP Method 198.1 (friable in NY) ☐ NY ELAP Method 198.6 NOB (non-friable-NY) ☐ OSHA ID-191 Modified ☐ Standard Addition Method		☐ TEM EPA NOB - EPA 600/R-93/116 Section 2.5.5.1 ☐ NY ELAP Method 198.4 (TEM) ☐ Chatfield Protocol (semi-quantitative) ☐ TEM % by Mass - EPA 600/R-93/116 Section 2.5.5.2 ☐ TEM Qualitative via Filtration Prep Technique ☐ TEM Qualitative via Drop Mount Prep Technique Other: ☐	
☐ Check For Positive Stop - Clearly Identify Homogenous Group		Date Sampled: <u>10/17/2024</u>	
Samplers Name: <u>Bill Perick</u>		Samplers Signature: <u>Bill Perick</u>	
Sample #	HA #	Sample Location	Material Description
<u>A-1,2,3</u>	<u>1</u>	<u>Kitchen</u>	<u>Brown Floor Tiles & mastic</u>
<u>A-4,5,6,7,8</u>	<u>2</u>	<u>Living Room, Kitchen, Bedrooms</u>	<u>Tan 9'x9" Floor Tiles & mastic</u>
<u>A-9,10,11</u>	<u>3</u>	<u>Store Room</u>	<u>Brown Linoleum & mastic</u>
<u>A-12,13,14,15,16</u>	<u>4</u>	<u>Throughout</u>	<u>White Tan drywall ceiling</u>
<u>A-17,18,19</u>	<u>5</u>	<u>Living room</u>	<u>Tan & white drywall and JC</u>
<u>A-20,21,22,23,24</u>	<u>6</u>	<u>Bedrooms, Hall, Kitchen</u>	<u>White drywall & JC</u>
<u>R-1,2,3,4,5</u>	<u>7</u>	<u>Roof</u>	<u>Brown Shingles, TAR, Felt paper</u>
Client Sample # (s): <u>A-1 then A-4, R-1 then R-5</u>		Total # of Samples: <u>29</u>	
Relinquished (Client): <u>Bill Perick (ECS)</u>		Date: <u>10/17/2024</u>	Time: <u>1520</u>
Received (Lab): <u>Per B</u>		Date: <u>10/17/24</u>	Time: <u>3:20 pm</u>
Comments/Special Instructions:			

Walker

Appendix IV: Asbestos Demolition Permit Form

MISSISSIPPI ASBESTOS DEMOLITION/RENOVATION NOTIFICATION FORM

Mail notification to: **MDEQ Asbestos Section, 515 E. Amite Street, Jackson, MS 39201**

Operator Project #		Postmark		Date Received (MDEQ use only)		Notification # (MDEQ use only)	
I. Type of Notification (O=Original R=Revised C=Canceled A= Annual)							
II. TYPE OF OPERATION (D=Demo O= Ordered Demo R=Renovation E=Emer. Renovation)							
III. FACILITY DESCRIPTION (Include building name, number and floor or room number)							
Bldg. Name:							
Address							
City:			State:		Zip:		
Site Location:					Tel:		
Building Size			# of Floors:		Age in Years:		
Present Use:			Prior Use:				
IV. FACILITY INFORMATION (Identify owner, removal contractor, and other operator)							
OWNER NAME:							
Address:							
City:			State:		Zip:		
Contact:					Tel:		
REMOVAL CONTRACTOR							
Address:							
City:			State:		Zip:		
Contact:					Tel:		
OTHER OPERATOR:							
Address:							
City:			State:		Zip:		
Contact:							
V. IS ASBESTOS PRESENT? (Yes/No)							
VI. PROCEDURE, INCLUDING ANALYTICAL METHOD, IF APPROPRIATE, USED TO DETECT THE PRESENCE OF ASBESTOS MATERIAL (Include inspector name and date of inspection):							
VII. APPROXIMATE AMOUNT OF ASBESTOS INCLUDING:		RACM To Be Removed	Nonfriable Asbestos Material Not To Be Removed		Indicate Unit of Measurement Below		
1. Regulated ACM to be Removed 2. Category I ACM Not Removed 3. Category II ACM Not Removed			Category I	Category II	UNIT		
Pipes					LnFt:	Ln M:	
Surface Area					SqFt:	Sq M:	
Vol RACM Off Facility Component					CuFt:	Cu M:	
VIII. SCHEDULED DATES ASBESTOS REMOVAL (MM/DD/YY) Start:						Complete:	
IX. SCHEDULED DATES DEMO/RENOVATION (MM/DD/YY) Start:						Complete:	

X. DESCRIPTION OF PLANNED DEMOLITION OR RENOVATION WORK, AND METHOD(S) TO BE USED:

XI. DESCRIPTION OF WORK PRACTICES AND ENGINEERING CONTROLS TO BE USED TO PREVENT EMISSIONS OF ASBESTOS AT THE DEMOLITION OR RENOVATION SITE:

XII. WASTE TRANSPORTER #1

Name:

Address:

City:

State:

Zip:

Contact Person:

Tel:

WASTE TRANSPORTER #2

Name:

Address:

City:

State:

Zip:

Contact Person:

Tel:

XIII. WASTE DISPOSAL SITE

Name:

Address:

City:

State:

Zip:

Tel:

XIV. IF DEMOLITION ORDERED BY A GOVERNMENT AGENCY, PLEASE IDENTIFY THE AGENCY BELOW:

Name:

Title:

Authority:

Date of Order (MM/DD/YY):

Date Ordered to Begin (MM/DD/YY):

XV. FOR EMERGENCY RENOVATIONS:

Date and Hour of Emergency (MM/DD/YY):

Description of the sudden unexpected event:

Explanation of how the event caused unsafe conditions or would cause equipment damage or an unreasonable financial burden:

XVI. DESCRIPTION OF PROCEDURES TO BE FOLLOWED IN THE EVENT THAT UNEXPECTED ASBESTOS IS FOUND OR PREVIOUSLY NONFRIABLE ASBESTOS MATERIAL BECOMES CRUMBLED, PULVERIZED, OR REDUCED TO POWDER:

XVII. I CERTIFY THAT AN INDIVIDUAL TRAINED IN THE PROVISIONS OF THIS REGULATION (40 CFR PART 61, SUBPART M) WILL BE ONSITE DURING THE DEMOLITION OR RENOVATION, AND EVIDENCE THAT THE REQUIRED TRAINING HAS BEEN ACCOMPLISHED BY THIS PERSON WILL BE AVAILABLE FOR INSPECTION DURING NORMAL BUSINESS HOURS.

Type or Print Name

(Signature of Owner/Operator)

(Date)

XVIII. I CERTIFY THAT THE ABOVE INFORMATION IS CORRECT:

Type or Print Name

(Signature of Owner/Operator)

(Date)

Mississippi Department of Environmental Quality
515 E. Amite Street
Jackson, MS 39201

December 2016

Instructions for Demolition and Renovation Form:

Top of form. The *"Operator Project #"* and *"Postmark"* spaces are for facility use if needed by any owner/operator project identification and to report the date the notification is mailed. *Please use the above address to mail or hand deliver notifications to MDEQ.*

The *"Date Received"* and *"Notification #"* are spaces intended for MDEQ use only.

Section I. Select from the choices provided.

Section II. Select from the choices provided.

Section III. An entry is needed for each listed item. The information for each item is a requirement of the regulations.

Section IV. Identify the responsible owner, removal contractor, and other operator (if applicable) and give complete address and contact information for each. The asbestos removal contractor must operate under a valid certification license from MDEQ and all others performing asbestos abatement activity must have the appropriate asbestos abatement certification.

Section V. Select from the choices provided and identify the asbestos material found. Note: The determination of the presence of asbestos requires a thorough inspection of the facility subject to the demolition or renovation operation and the individual performing this inspection must have MDEQ asbestos abatement *Inspector* certification.

Section VI. Please refer to the Note for Section V above. Give name of inspector and inspection date. Also, identify every material suspected/tested for asbestos and the test methodology.

Section VII. Use the *"RACM to be Removed"* column to provide the approximate amount of friable asbestos material to be removed. This includes non-friable Category I material that has become friable or Category I material that will or has been subjected sanding, grinding, cutting, or abrading. It also includes Category II non-friable material that has a high probability of becoming or has become crumbled, pulverized, or reduced to powder by the forces expected to act on the material in the course of demolition or renovation operations.

(Section VII instructions continue on the next page)

Use the “*Non-friable Asbestos Material Not To Be Removed*” columns only for Demolition operations where Category I and/or Category II material will be left in place. Enter for each type of material the approximate amount to not be removed in advance of the demolition operation.

Use the “Unit” columns to identify unit(s) of measurement for the asbestos amounts reported for #1, #2, and #3.

Section VIII. Provide the dates for both the actual start and expected completion of asbestos removal. Changes in these dates should be reported in a “Revised” notification to MDEQ.

Section IX. Provide the dates for both the actual start and expected completion of the demolition and/or renovation operation or project. Changes in these dates should be reported in a “Revised” notification to MDEQ.

Section X. Tell of what is to be undertaken and why or how. For example, the removal of asbestos material to avoid any demolition or renovation disturbance of the material.

Section XI. Use this space to identify emission control procedures to be employed to satisfy the requirements of the regulation. For example, note emission control procedures/methods to be employed or used (adequate wetting, ploy containment, negative air, waste bagging/labeling, glove bags, etc.).

Section XII. Identify the responsible waste transporter(s) and give complete contact information for each.

Section XIII. Identify the waste disposal site to be used and give complete contact information. Asbestos waste must be deposited at a landfill waste disposal facility that is approved or permitted to receive asbestos waste. Permitted asbestos waste disposal sites in the State of Mississippi may be found on the MDEQ web site.

Section XIV. Each item listed for an *Ordered Demolition* must be answered to satisfy the requirements of the regulation.

Section XV. Each item listed for *Emergency Renovations* must be answered to satisfy the requirements of the regulations.

Section XVI. In the event of unexpected asbestos being discovered during the performance of a demolition or renovation operation, immediate steps should be taken to bring operations into compliance with the regulations. This may require operations to be halted and conditions secured, and discussions with MDEQ for the proper course of action.

Signatures. The notification should be signed (both certifications) by the owner and/or operator in control of the regulated activity, or that person's authorized representative. Please include the typed or printed name with each signature.

Submission. Project notifications should be mailed or delivered to:

MDEQ Asbestos Section
515 E. Amite Street
Jackson, MS 39201

Appendix V: Certifications/ Licenses

State of Mississippi

*Department of Environmental Quality
Office of Pollution Control*

Certificate of Licensure

In accordance with the Asbestos Abatement Accreditation and Certification Act,
Enacted as 1989 Mississippi Law, Chapter 505

Be it known that

William F Penick

Having submitted acceptable evidence of qualifications and
training and other appropriate information, is hereby granted this


***Asbestos Inspector
Certification***



*Certificate No.: ABI-00009048
Expiration Date: Jul 19th, 2025
Training Expires on Jul 19th, 2025*

Chief, Asbestos & Lead Branch

73938 LIC20240001

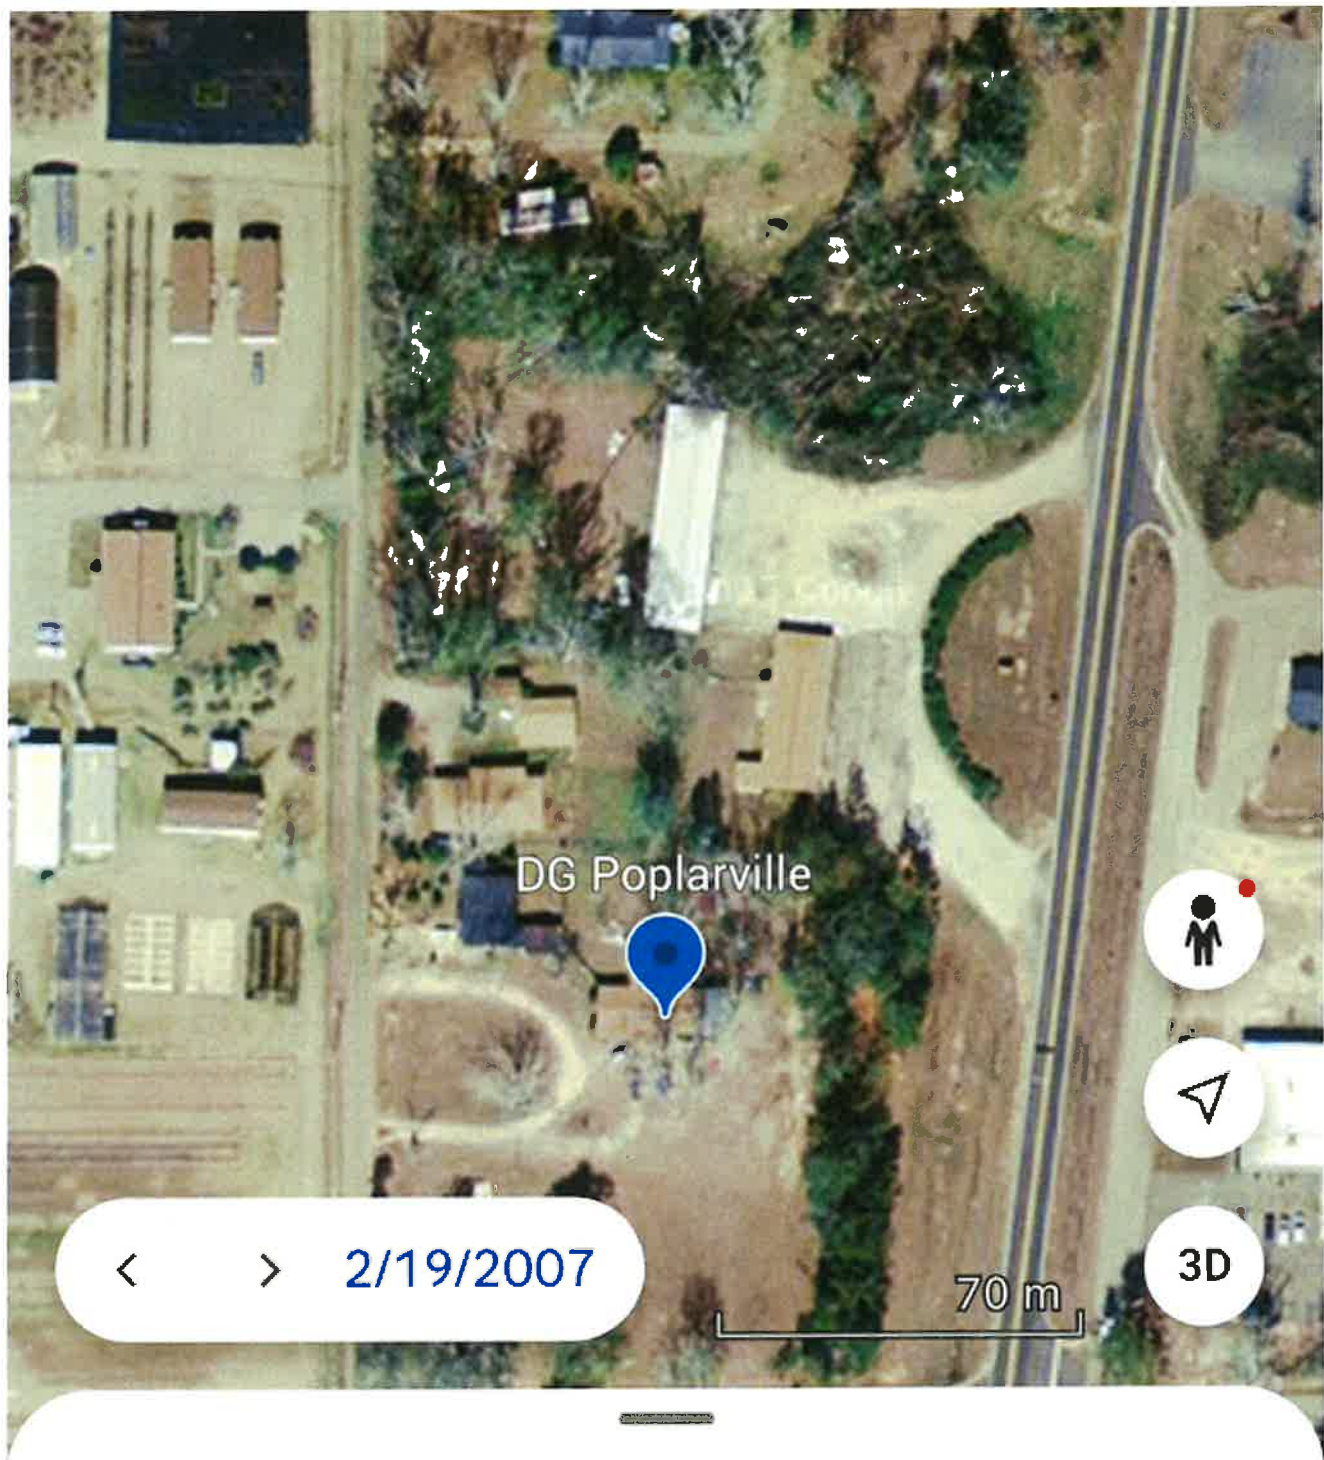

< DG Poplarville



Location

$30^{\circ}50'15''\text{N}$ $89^{\circ}32'36''\text{W}$

Accuracy (m)

0

